UNÎNEX

NAKATOMI

KOOLZONE

MOBILE SPOT COOLER

QUICK GUIDE FOR ***SAC-25FC***

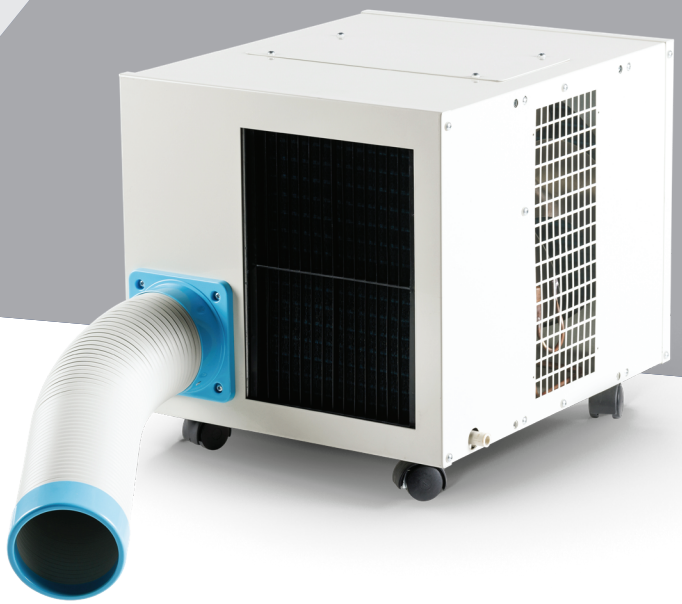

THANK YOU FOR PURCHASING THE KOOLZONE MOBILE SPOT COOLER.
PLEASE READ THE INSTRUCTIONS BEFORE USING.
KEEP THESE INSTRUCTIONS FOR REFERENCE.

UNINEX INTERNATIONAL

5780 SMITHWAY STREET COMMERCE, CA 90040

T. 800-864-3288 / 323-890-9246 / F. 323-890-9249

PARTS OF THE MACHINE

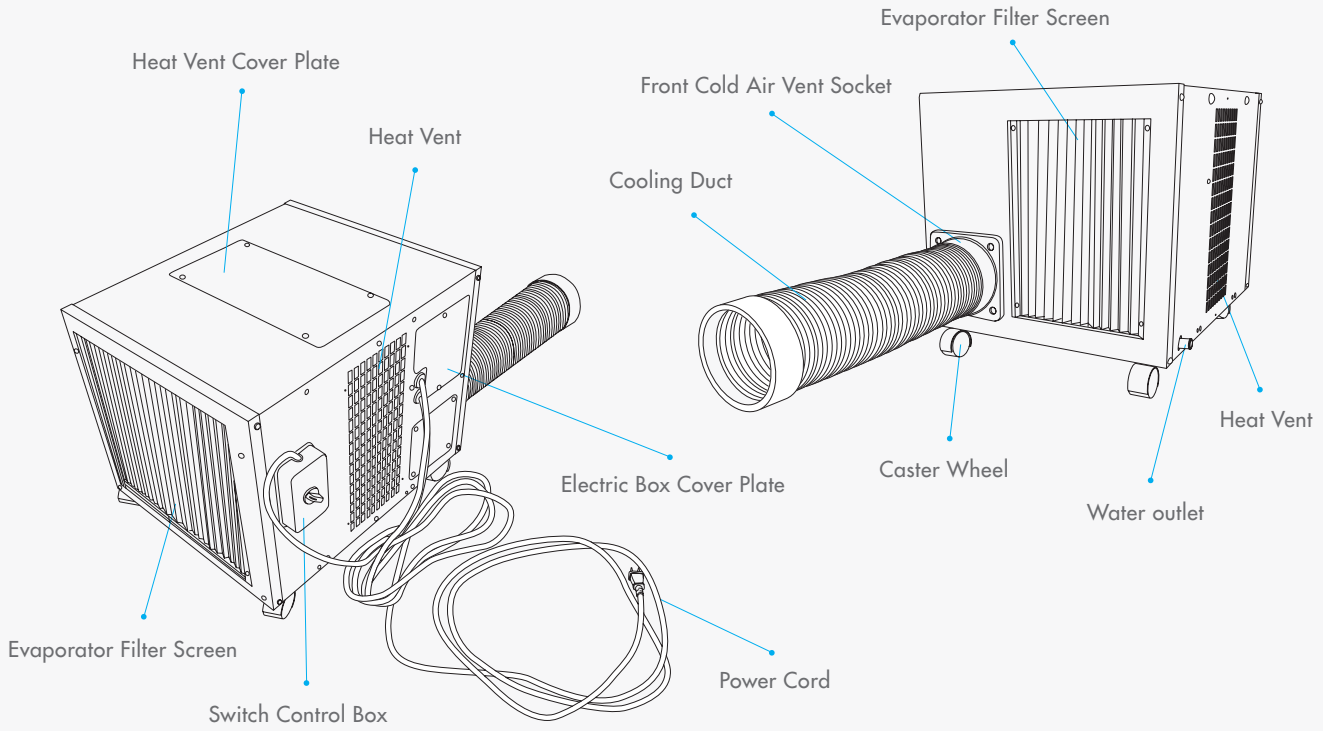

COOLING DUCT INSTALLATION

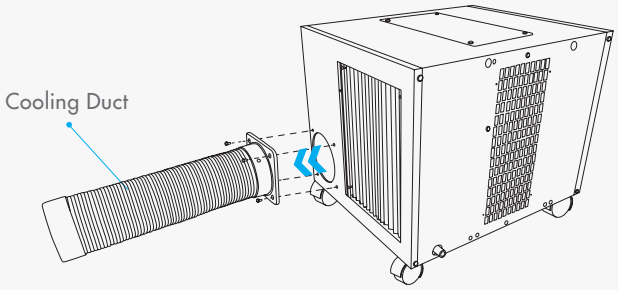

Cold Air Flow Side View

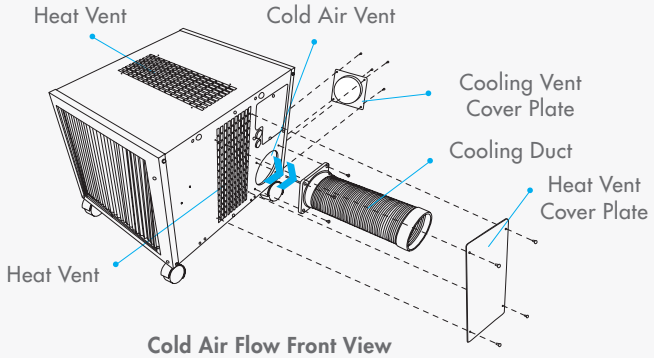

Cold Air Flow Front View

INSTALLATION

There are two cold air outlets. Both outlets can be used together (one cooling duct included).

Additional ducts can be purchased seperately. The cold air vent socket is fixed to the cold air vent on the air conditioner with four M5x12 screws (included). Select the direction needed and cover the other cold air vents with a cold air vent cover plate.

There are three heat outlets provided by the air conditioner.

Depending on the situation, the heat vent cover can be used on one or none of heat vents.

SWITCH CONTROL BOX INSTALLATION

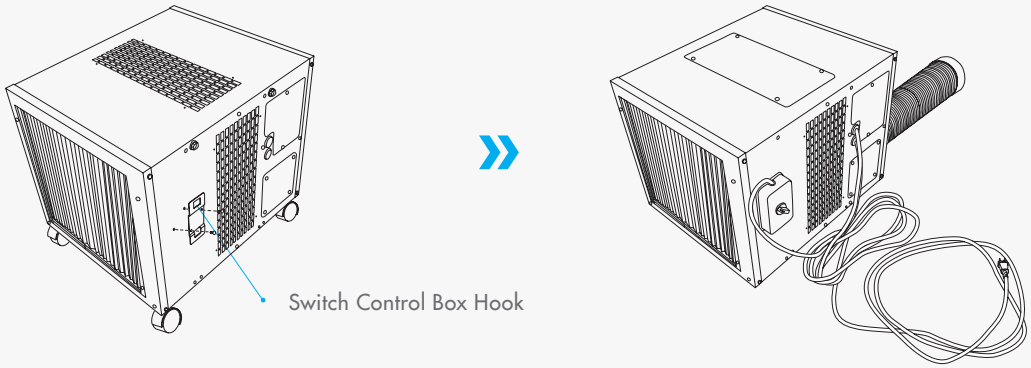

INSTALLATION

The switch control box hook is attached to the side of the unit (as illustrated below). Connect the switch control box to the hook.

SWITCH CONTROL BOX OVERVIEW

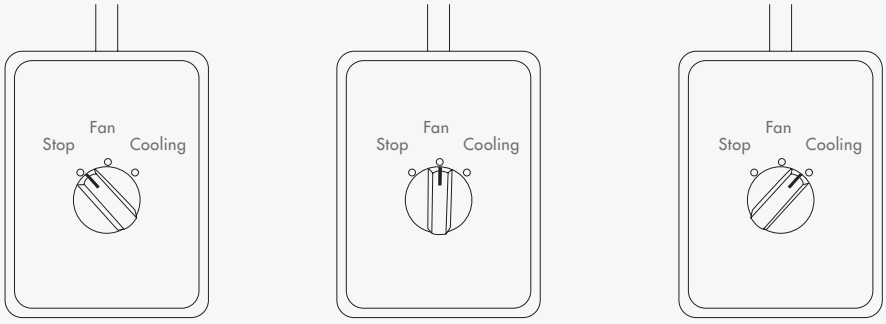

STOP FAN COOLING

HOW TO OPERATE AND SELECT FUNCTIONS

- Set the switch to fan mode and the fan will start. The unit will emit ambient air.
- At fan mode setting the compressor will not work.
- Set the switch on cooling mode, the compressor will start and cold air will flow from the AC unit.
- Set the switch to the stop, AC unit will turn off.

⚠ NOTIFICATION

- Operating temperature is between 77°F to 113°F.
- If you use the unit out of the temperature range, it may not work properly.
- Do not overload the electrical system by using too many devices off one outlet.

IMPORTANT - KEEP DISTANCE

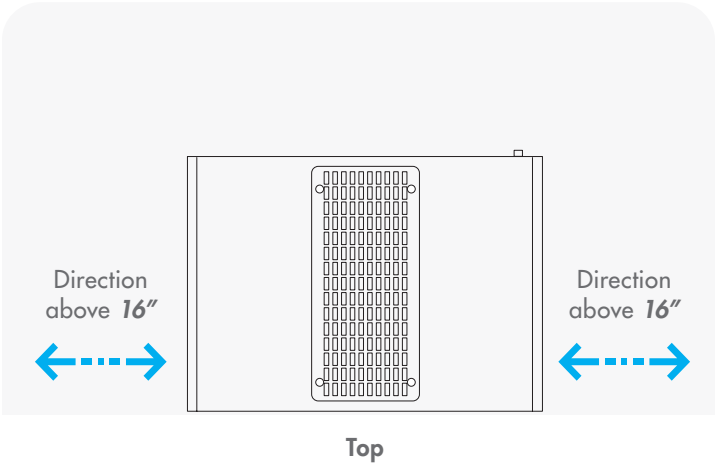

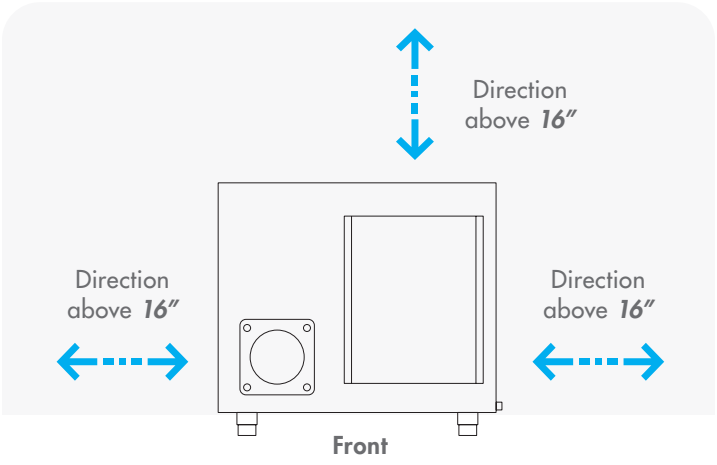

INSTALLING THE DRAIN HOSE

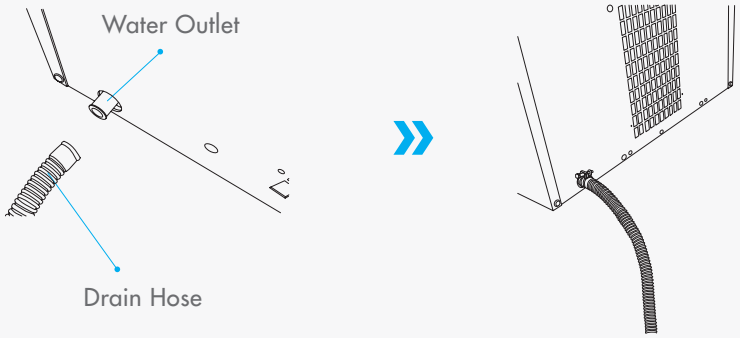

KOOLZONE MANUFACTURER'S RECOMMENDATIONS



1. USE A DEDICATED OUTLET. DO NOT SHARE AN OUTLET WITH OTHER DEVICES. SHARING AN OUTLET MAY CAUSE A POWER OUTAGE.

2. IF USING AN EXTENSION CORD, A 12 AWG IS RECOMMENDED.

3. DO NOT BLOCK THE HEAT EXHAUST DUCT. BLOCKING THE HEAT EXHAUST COULD CAUSE THE UNIT TO OVERHEAT AND STOP WORKING PROPERLY.

4. FOR OPTIMUM PERFORMANCE, USE ONLY UP TO A MAXIMUM OF 12 FT OF HEAT/COOL EXTENSION DUCT.

PLEASE NOTE

OPTIMUM OPERATING TEMPERATURE RANGE FOR

KOOLZONE MOBILE SPOT A/C COOLER

IS FROM ***77°*** - ***113°*** FAHRENHEIT.

WHEN USING THIS UNIT ON COOLING MODE,

THE AMBIENT TEMPERATURE WILL BE REDUCED

BETWEEN ***10°*** - ***15°*** FAHRENHEIT.

MAKE LIFE SIMPLE AND MORE CONVENIENT
WITH UNINEX

SCAN ME

CONTACT US FOR PURCHASE OR RENTAL

UNÎNEX

EXCLUSIVELY DISTRIBUTED BY:
UNINEX INTERNATIONAL
5780 SMITHWAY STREET COMMERCE, CA 90040
T. 800-864-3288 / 323-890-9246 / F. 323-890-9249

NAKATOMI

MANUFACTURE:
NAKATOMI CO.,LTD.
6445-2, TAKAI, TAKAYAMA, KAMITAKAI, NAGANO, JAPAN